

Overview

The EC-Net^{AX} Alarm Console is a flexible client application for monitoring alarms from EC-BOS^{AX} or Supervisor nodes and provides a low cost way for users that do not require the full EC-Net^{AX} Pro to monitor, acknowledge and review current alarms within a building or campus. This is a “thick-client” application designed to be loaded on the user’s PC for remote alarm monitoring of one or more EC-BOS^{AX} or a Supervisor. Multiple copies can be purchased to allow users with different responsibilities to monitor only the things for which they are responsible. A security office can have a copy to monitor only security alarms and a HVAC technician can have a copy to monitor critical building systems, each with his/her own console.

Applications

- Can monitor EC-BOS^{AX} or Supervisor via standard notification class connection.
- Sophisticated alarm processing and routing, including e-mail and paging.
- Supports multiple EC-BOS-NXS^{AX}, EC-BOS-2^{AX}, EC-BOS-6^{AX}, EC-BOS-403^{AX} or EC-BOS-545^{AX} stations connected to a local Ethernet network, or the Internet via the standard notification class connection(s).

Features & Benefits

- Thick-client application for installation on a user’s PC.
- Provides standalone Alarm Monitor capability for those users not requiring a full system engineering tool.
- Alarm view allows user to view current alarms as well as those previously acknowledged.
- Hyperlinks (if used) in alarms may be used to “go to” the Web page where the alarm point is displayed graphically to view more information.
- Password protection and security using standard Java authentication and encryption techniques.

Product Warranty & Total Quality Commitment

All Distech Controls product lines are built to meet rigorous quality standards and carry a two-year warranty. Distech Controls is an ISO 9001 registered company.


EC-Net^{AX} Alarm Console Versions and Drivers

EC-ALM-CONSOLE-AX Alarm Console client for EC-BOS^{AX} or Web Supervisor; one copy per user/PC.

Platform Requirements

Processor:	Intel Pentium™ IV, 2 GHz or higher or AMD equivalent
Operating System:	Microsoft 32 or 64 bit versions: Microsoft Windows® 2000, Windows Vista, or Windows XP Professional®, Windows 2003 Server® (if Microsoft IIS is disabled)
Memory:	1GB or higher as recommended by operating system manufacturer
Hard Drive:	1 GB minimum, 5 GB for applications that need more archiving capacity
Display:	Video card and monitor capable of displaying 1024 x 768 pixel resolution or greater
Network Support:	Ethernet adapter (10/100MB with RJ-45 connector)
CD-ROM	For software installation
Modem:	56KB minimum, full time high-speed ISP connection recommended for remote site access (i.e. T1, ADSL, cable modem)

Typical Architecture

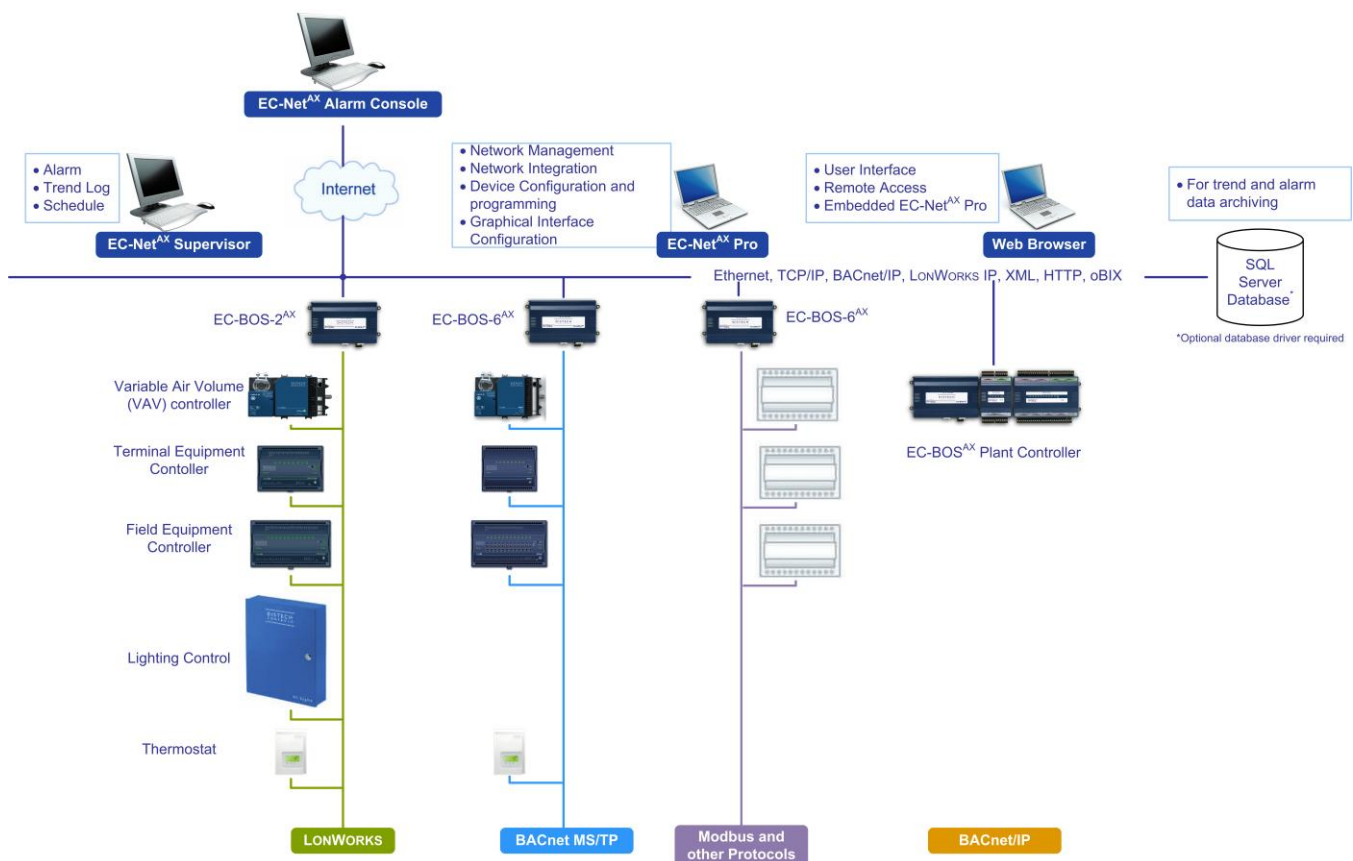

The above architecture is shown as an example only.

Distech Controls logo is a trademark of Distech Controls Inc.;

Specifications subject to change without notice or liability to provide changes to prior purchasers. Information and specifications published here are current as of the date of publication of this document. Distech Controls reserves the right to change or modify specifications without prior notice. Products or features contained herein may be covered by one or more U.S. or foreign patents. BACnet is a trademark of ASHRAE. The BTL logo is a registered trademark of BACnet International. Modbus is a trademark of Schneider Electric. OPC is a registered trademark of the OPC foundation. Windows, Windows Vista Ultimate, Windows XP Professional and Windows Server 2003 are registered trademarks of Microsoft Corporation. Niagara^{AX} Framework is a trademark of Tridium Inc. ©2007 and 2009 Distech Controls Inc.



05DI-DSEASAX-11

EC-Net^{AX} Alarm Console

www.distech-controls.com